

Mt Piper Power Station

Monthly Environment Monitoring Data

Prepared by:
Mt Piper Environment Team

List of Tables

Table 1: Compliance Summary:	3
Table 2: Details of any Licence Monitoring Limit not met:	3
Table 3: Water Quality at EPL Point 12	7
Table 4: Nitrogen Oxides (NO _x) Monitoring at EPL Points 2 and 3	8
Table 5: Sulphur Dioxides (SO ₂) Monitoring at EPL Points 2 and 3	9
Table 6: Oxygen (O ₂), Temperature & Moisture Monitoring at EPL Points 2 and 3	10
Table 7: Quarterly Stack Emissions Monitoring at EPL Points 2 and 3	11
Table 8: Six Monthly Stack Emissions Monitoring at EPL Points 2 and 3	11
Table 9: Ambient Air Quality at Blackmans Flat, Wallerawang & Newnes Plateau	13
Table 10: TCR Water Quality and TCR Riparian Release	15

List of Figures

Figure 1: Nitrogen Dioxide (NO _x) Emission Data	4
Figure 2: Sulphur Dioxide (SO ₂) Emission Data	5
Figure 3: Solid particles Emission Data	6
Figure 4: MPPS PM _{2.5} (µg/m ³) Daily Average	14
Figure 5: MPPS NO ₂ pphm Daily Average	14
Figure 6: MPPS SO ₂ pphm Daily Average	14
Figure 7: TCR Water Level	15


EPL Number: 13007
 EPL Holder: EnergyAustralia NSW
 EPL Name of Facility: MOUNT PIPER POWER STATION
 EPL Address of Facility: 350 BOULDER RD PORTLAND, NSW 2847
 EPL Website link: [Environment & Heritage | POEO Licences, Application and Notice Detail \(nsw.gov.au\)](https://www.environment.nsw.gov.au/poecol/Pages/POEO-Licences-Application-and-Notice-Detail.aspx?Licence=13007)
 EPL Monitoring Locations: <https://www.energyaustralia.com.au/about-us/energy-generation/mt-piper-power-station/mt-piper-epa-reports>
 EPL Unit of measure abbreviations: <https://www.energyaustralia.com.au/about-us/energy-generation/mt-piper-power-station/mt-piper-epa-reports>
 EPL Period monitored: 1 – 31 May 2025
 Monthly Summary Status: Complete: monitoring data obtained.

Table 1: Compliance Summary:

Were all licence monitoring limits met:	YES
---	-----

Table 2: Details of any Licence Monitoring Limit not met:


License Point #	Air/Water/Noise	Pollutant	Value measured	Licence limit	Comments
NIL	-	-	-	-	-

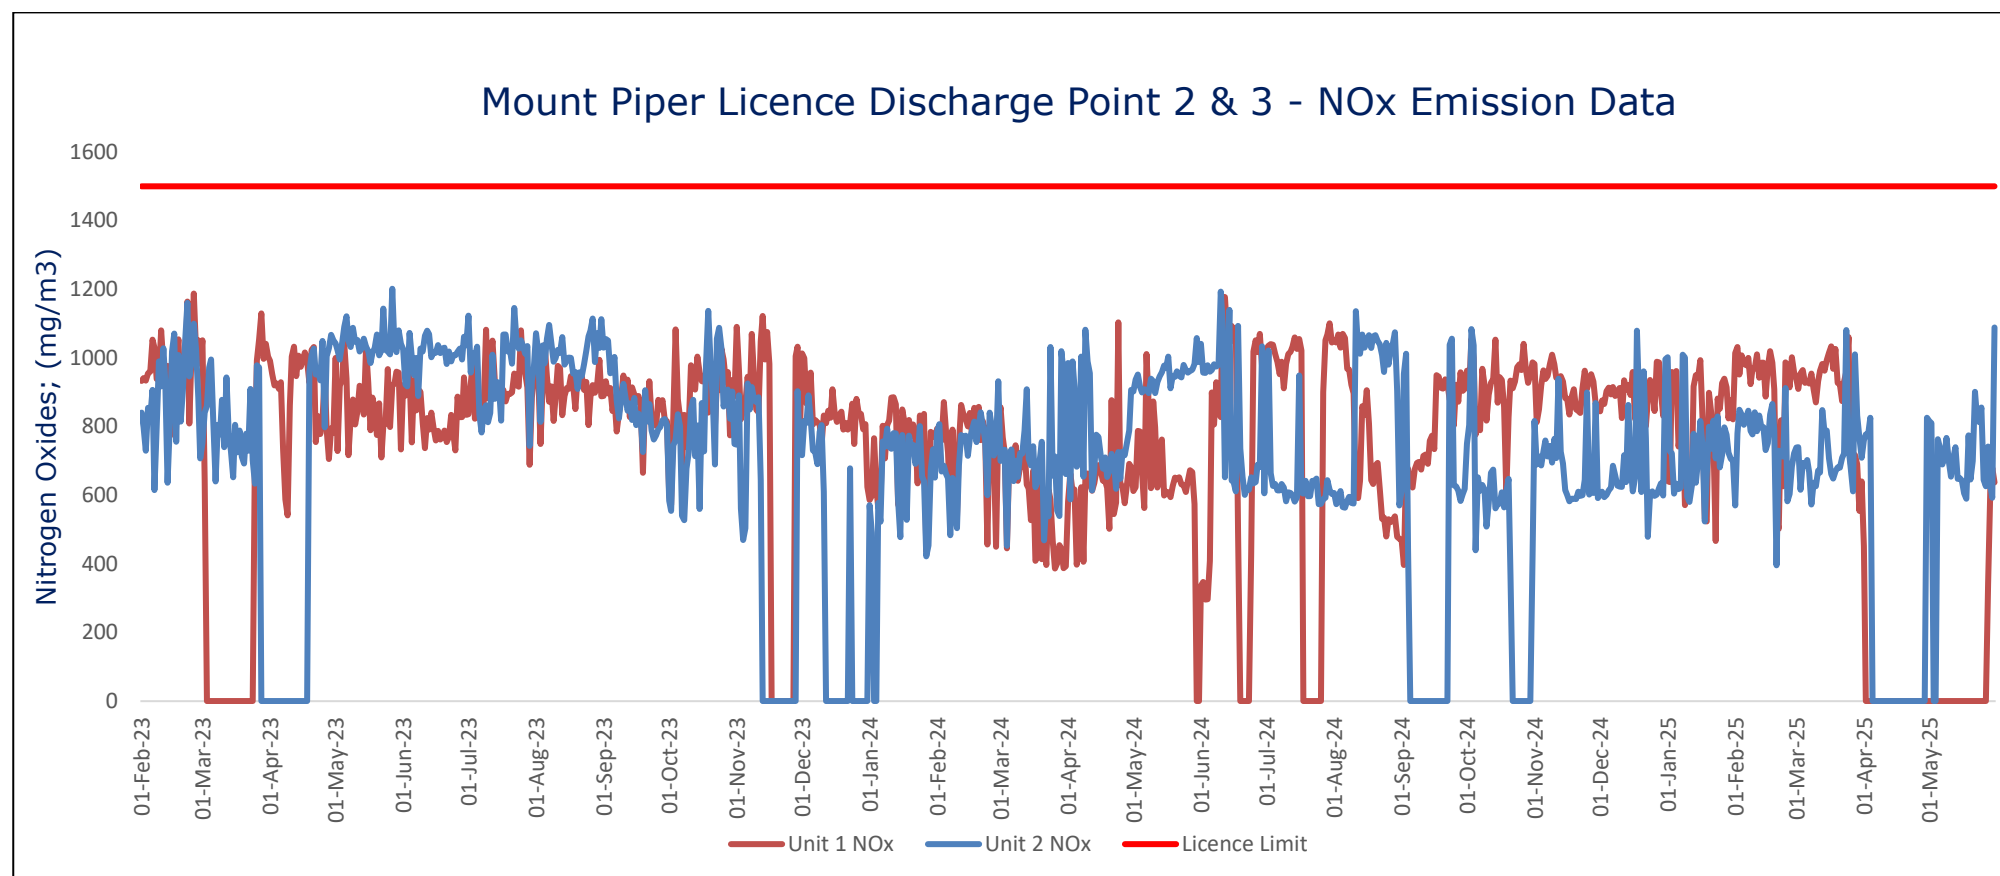

Note: Gap in data is due to periods when the unit was shut down, or the monitoring equipment was offline.

Source: Data is obtained from the Continuous Emission Monitoring System.


Figure 1: Nitrogen Dioxide (NO_x) Emission Data

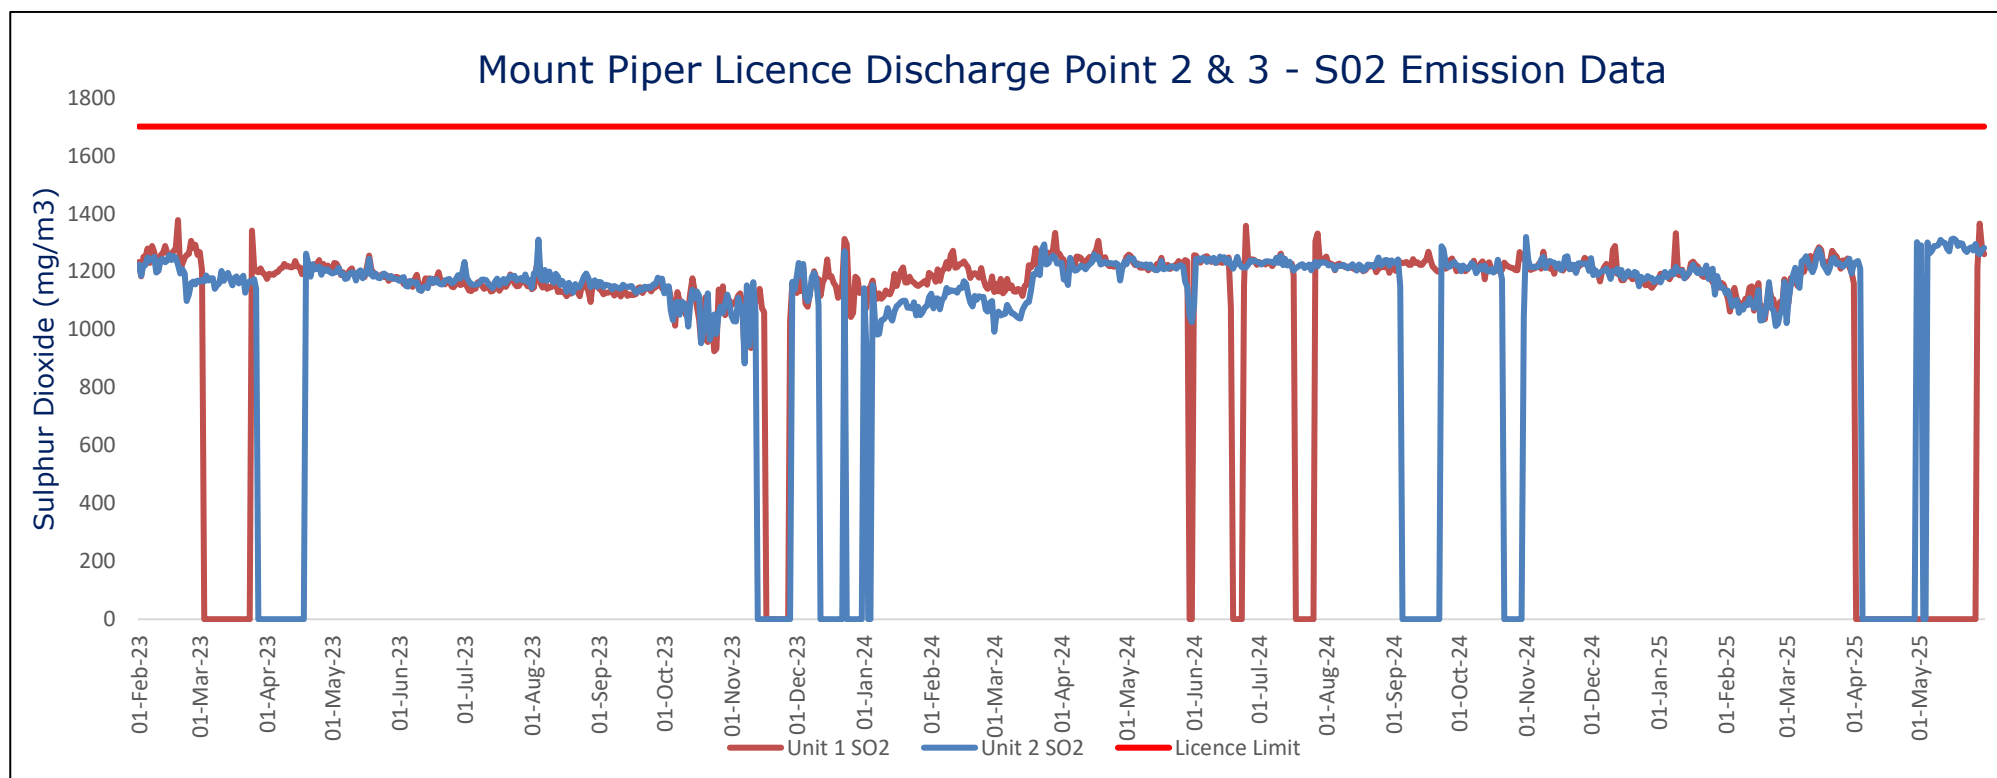

Note: Gap in data is due to periods when the unit was shut down, or the monitoring equipment was offline.

Source: Data is obtained from the Continuous Emission Monitoring System.

Figure 2: Sulphur Dioxide (SO₂) Emission Data

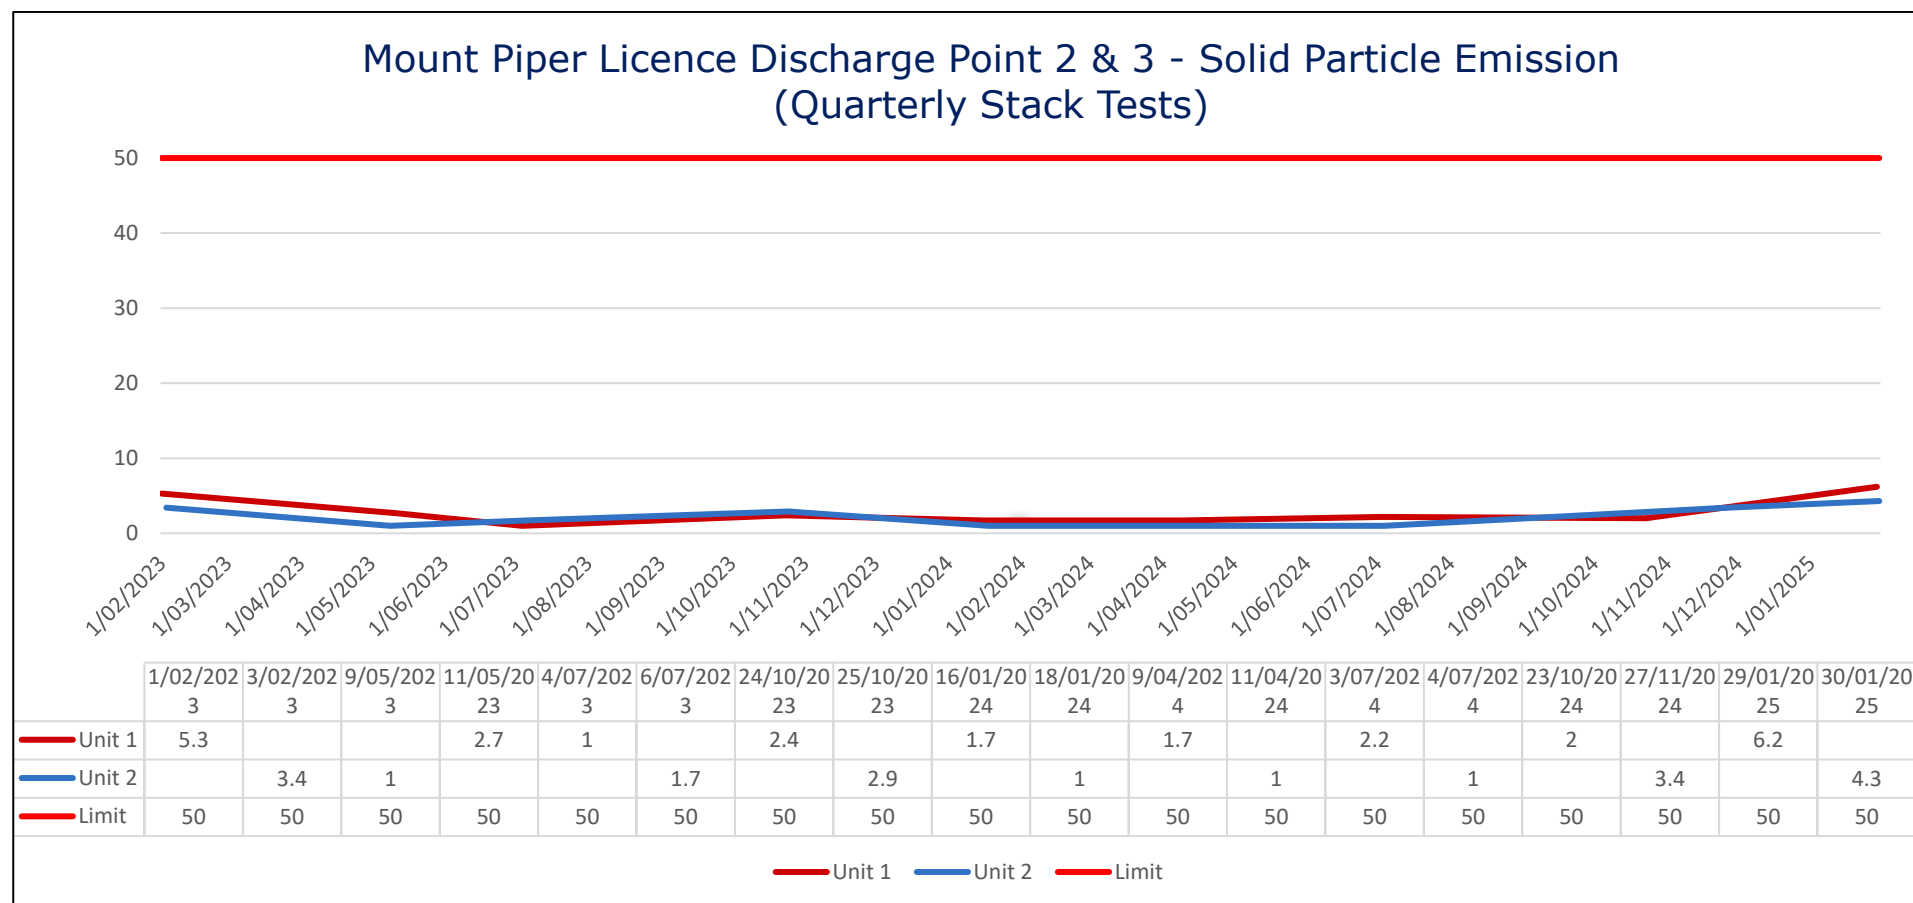

Note: Gap in data is due to periods when the unit was shut down, or the monitoring equipment was offline.

Source: Data is obtained from the Quarterly Stack Testing conducted by Ektimo.

Figure 3: Solid particles Emission Data

Discharge to Water

Table 3: Water Quality at EPL Point 12

2025	Samples required by EPL (1/mth during discharge)	No. of samples during month	Conductivity (µS/cm)		Oil & Grease (mg/L)		pH		Total Suspended Solids (mg/L)		Turbidity (NTU)		Compliant	Comment
			Result	Limit	Result	Limit	Result	Limit	Result	Limit	Result	Limit		
January	1	2	414	500	<5	10	7.32	6.5-8.5	3.33	50	3.17	25	Yes	Flow / Discharge recorded week of 9/01/2025
			434		<5		7.50		15.67		19.90		Yes	Flow / Discharge recorded week of 14/01/2025
February	1	2	366	500	<5	10	7.37	6.5-8.5	5.00	50	4.58	25	Yes	Flow / Discharge recorded week of 12/02/2025
			471		<5		7.75		1.33		3.87		Yes	Flow / Discharge recorded week of 26/02/2025
March	0	0	NR	500	NR	10	NR	6.5-8.5	NR	50	NR	25	Yes	Not sampled due to no flow / no discharge
April	1	1	433	500	<5	10	7.12	6.5-8.5	16.00	50	6.02	25	Yes	Flow / Discharge recorded week of 29/04/2025
May	1	2	433	500	<5	10	7.12	6.5-8.5	16.00	50	6.02	25	Yes	Flow/Discharge record week of 2/05/2025
			317		<5		6.85		13.00		4.02		Yes	Flow/Discharge record week of 29/05/2025
June				500		10		6.5-8.5		50		25		
July				500		10		6.5-8.5		50		25		
August				500		10		6.5-8.5		50		25		
September				500		10		6.5-8.5		50		25		
October				500		10		6.5-8.5		50		25		
November				500		10		6.5-8.5		50		25		
December				500		10		6.6-8.5		50		25		

Air Emissions

Table 4: Nitrogen Oxides (NOx) Monitoring at EPL Points 2 and 3

2025	No. of samples required by licence	EPL Point	Lowest sample value (mg/m ³ , hourly average)	Mean of sample (mg/m ³)	Highest sample value (mg/m ³ , hourly average)	Limit (mg/m ³ , hourly average)	99 th percentile			Compliant
							Limit (mg/m ³)	87 1-hr averaging periods/yr	1hr averaging periods > limit	
January	Continuous	2	230	556	994	1500	1,100	87	0	Yes
		3	275	475	1009			87	0	Yes
February	Continuous	2	252	644	1032	1500	1,100	87	0	Yes
		3	242	507	912			87	0	Yes
March	Continuous	2	246	602	1060	1500	1,100	87	0	Yes
		3	288	497	1081			87	0	Yes
April	Continuous	2	327	392	451	1500	1,100	87	0	Yes
		3	307	634	826			87	0	Yes
May	Continuous	2	304	502	680	1500	1,100	87	0	Yes
		3	264	551	1088			87	0	Yes
June	Continuous	2				1500	1,100		0	
		3							0	
July	Continuous	2				1500	1,100		0	
		3							0	
August	Continuous	2				1500	1,100		0	
		3							0	
September	Continuous	2				1500	1,100		0	
		3							0	
October	Continuous	2				1500	1,100		0	
		3							0	
November	Continuous	2				1500	1,100		0	
		3							0	
December	Continuous	2				1500	1,100		0	
		3							0	

Source: Data is obtained from Continuous Emission Monitoring System

Table 5: Sulphur Dioxides (SO₂) Monitoring at EPL Points 2 and 3

2025	No. of samples required by licence	EPL Point	Lowest sample value (mg/m ³ , hourly average)	Mean of sample (mg/m ³)	Highest sample value (mg/m ³ , hourly average)	Limit (mg/m ³ , hourly average)	99 th percentile			Compliant
							Limit (mg/m ³)	87 1-hr averaging periods/yr	1hr averaging periods > limit	
January	Continuous	2	740	1147	1332	1700	1,400	87	0	Yes
		3	760	1155	1224			87	0	Yes
February	Continuous	2	772	1035	1173	1700	1,400	87	0	Yes
		3	785	1027	1165			87	0	Yes
March	Continuous	2	899	1146	1284	1700	1,400	87	0	Yes
		3	885	1138	1277			87	0	Yes
April	Continuous	2	1045	1106	1160	1700	1,400	87	0	Yes
		3	991	1183	1301			87	0	Yes
May	Continuous	2	1205	1250	1365	1700	1,400	87	0	Yes
		3	1034	1252	1314			87	0	Yes
June	Continuous	2				1700	1,400		0	
		3							0	
July	Continuous	2				1700	1,400		0	
		3							0	
August	Continuous	2				1700	1,400		0	
		3							0	
September	Continuous	2				1700	1,400		0	
		3							0	
October	Continuous	2				1700	1,400		0	
		3							0	
November	Continuous	2				1700	1,400		0	
		3							0	
December	Continuous	2				1700	1,400		0	
		3							0	

Source: Data is obtained from the Continuous Emission Monitoring System

Table 6: Oxygen (O₂), Temperature & Moisture Monitoring at EPL Points 2 and 3

2025	No. of samples required by licence	EPL Point	Oxygen			Temperature			Moisture		
			Lowest sample value (%, hourly average)	Mean of sample (%)	Highest sample value (%, hourly average)	Lowest sample value (°C, hourly average)	Mean of sample (°C)	Highest sample value (°C, hourly average)	Lowest sample value (H ₂ O, hourly average)	Mean of sample (H ₂ O)	Highest sample value (H ₂ O, hourly average)
January	Continuous	2	6.0	9.0	11.0	105	117	131	4.4	6.9	8.7
		3	6.6	9.5	11.6	105	114	131	4.1	6.6	8.2
February	Continuous	2	7.4	9.4	14.1	91	115	131	3.7	6.8	8.9
		3	7.6	9.8	14.0	101	113	129	3.7	6.4	8.3
March	Continuous	2	7.4	9.0	13.9	90	117	131	4.6	6.9	8.5
		3	7.8	9.4	13.9	101	112	133	4.5	6.5	8.1
April	Continuous	2	8.9	10.6	11.9	97	105	117	5.4	5.9	6.6
		3	7.9	8.7	12.6	103	114	122	4.3	6.4	7.4
May	Continuous	2	7.6	8.7	11.1	82	113	128	5.2	6.5	7.3
		3	6.7	9.0	11.7	86	114	128	4.9	6.5	8.2
June	Continuous	2									
		3									
July	Continuous	2									
		3									
August	Continuous	2									
		3									
September	Continuous	2									
		3									
October	Continuous	2									
		3									
November	Continuous	2									
		3									
December	Continuous	2									
		3									

Source: Data is obtained from the Continuous Emission Monitoring System

Table 7: Quarterly Stack Emissions Monitoring at EPL Points 2 and 3

2025	No. of samples required by EPL per year	EPL Point	Samples taken (year to date)	Result				Limit	Compliant
				Q1	Q2	Q3	Q4		
Solid Particles (mg/m ³)	4	2	1	6.2				50	Yes
		3	1	4.3					Yes

Table 8: Six Monthly Stack Emissions Monitoring at EPL Points 2 and 3

2025	No. of samples required by EPL per year	EPL Point	Samples taken (year to date)	Result		Limit	Compliant
				Jan - Jun	Jul - Dec		
Carbon Dioxide (%)	2	2	1			-	
		3	1			-	
Cadmium (mg/m ³)	2	2	1	<0.0002		0.03	Yes
		3	1	<0.0002			Yes
Mercury (mg/m ³)	2	2	1	0.0021		0.03	Yes
		3	1	0.00077			Yes
Type 1 and Type 2 substances in aggregate (mg/m ³)	2	2	1	<0.03		0.60	Yes
		3	1	<0.03			Yes
Hydrogen Chloride (mg/m ³)	2	2	1			50	
		3	1				
Fluorine (mg/m ³)	2	2	1			30	
		3	1				
Chlorine (mg/m ³)	2	2	1			4	
		3	1				
Sulfuric Acid Mist and Sulfur Trioxide as SO ₃ (mg/m ³)	2	2	1			100	
		3	1				
Volatile Organic Compounds as n-propane equivalent (mg/m ³)	2	2	1			8	
		3	1				

Mt Piper Power Station

Ambient Monitoring Data

- Air Quality
- Thompsons Creek Reservoir Water Quality

Table 9: Ambient Air Quality at Blackmans Flat, Wallerawang & Newnes Plateau

2025	No. of samples required by licence	Parameter	Blackmans Flat			Wallerawang			Newnes		
			Min Daily Reading	Monthly Average	Max Daily Reading	Min Daily Reading	Monthly Average	Max Daily Reading	Blank	Newnes1	Newnes2
January	Continuous	SO ₂ (pphm)	-0.1	0.1	0.8	0.0	0.0	0.3	<0.9	<0.9	<0.9
		NO ₂ (pphm)	0.1	0.2	0.6	0.1	0.2	0.5	<0.6	<0.6	<0.6
		PM2.5 (µg/mg ³)	2.1	4.7	8.5	-0.7	4.9	9.4	NR	NR	NR
February	Continuous	SO ₂ (pphm)	0.0	0.2	0.3	0.0	0.0	0.2	<0.9	<0.9	<0.9
		NO ₂ (pphm)	0.1	0.3	0.6	0.1	0.3	0.6	<0.6	<0.6	<0.6
		PM2.5 (µg/mg ³)	2.2	5.1	8.0	0.1	4.6	9.2	NR	NR	NR
March	Continuous	SO ₂ (pphm)	-0.1	0.1	0.3	0.0	0.0	0.3	<0.9	<0.9	<0.9
		NO ₂ (pphm)	0.0	0.2	0.6	0.1	0.3	0.6	<0.6	<0.6	<0.6
		PM2.5 (µg/mg ³)	1.9	4.2	7.9	-1.4	3.2	8.0	NR	NR	NR
April	Continuous	SO ₂ (pphm)	0.0	0.1	0.2	0.0	0.0	0.0	<0.9	<0.9	<0.9
		NO ₂ (pphm)	0.1	0.4	0.7	0.1	0.4	0.7	<0.6	<0.6	<0.6
		PM2.5 (µg/mg ³)	2.4	5.7	26.0	0.0	5.2	25.1	NR	NR	NR
May	Continuous	SO ₂ (pphm)									
		NO ₂ (pphm)									
		PM2.5 (µg/mg ³)									
June	Continuous	SO ₂ (pphm)									
		NO ₂ (pphm)									
		PM2.5 (µg/mg ³)									
July	Continuous	SO ₂ (pphm)									
		NO ₂ (pphm)									
		PM2.5 (µg/mg ³)									
August	Continuous	SO ₂ (pphm)									
		NO ₂ (pphm)									
		PM2.5 (µg/mg ³)									
September	Continuous	SO ₂ (pphm)									
		NO ₂ (pphm)									
		PM2.5 (µg/mg ³)									
October	Continuous	SO ₂ (pphm)									
		NO ₂ (pphm)									
		PM2.5 (µg/mg ³)									
November	Continuous	SO ₂ (pphm)									
		NO ₂ (pphm)									
		PM2.5 (µg/mg ³)									
December	Continuous	SO ₂ (pphm)									
		NO ₂ (pphm)									
		PM2.5 (µg/mg ³)									

Note: In April PM2.5 at Blackmans Flat & Wallerawang went over 20 µg/m³ guideline. MPPS was offline at the time, the high levels were likely due to local smoke haze.

Source: Data is obtained from the Ambient Air Monthly Report

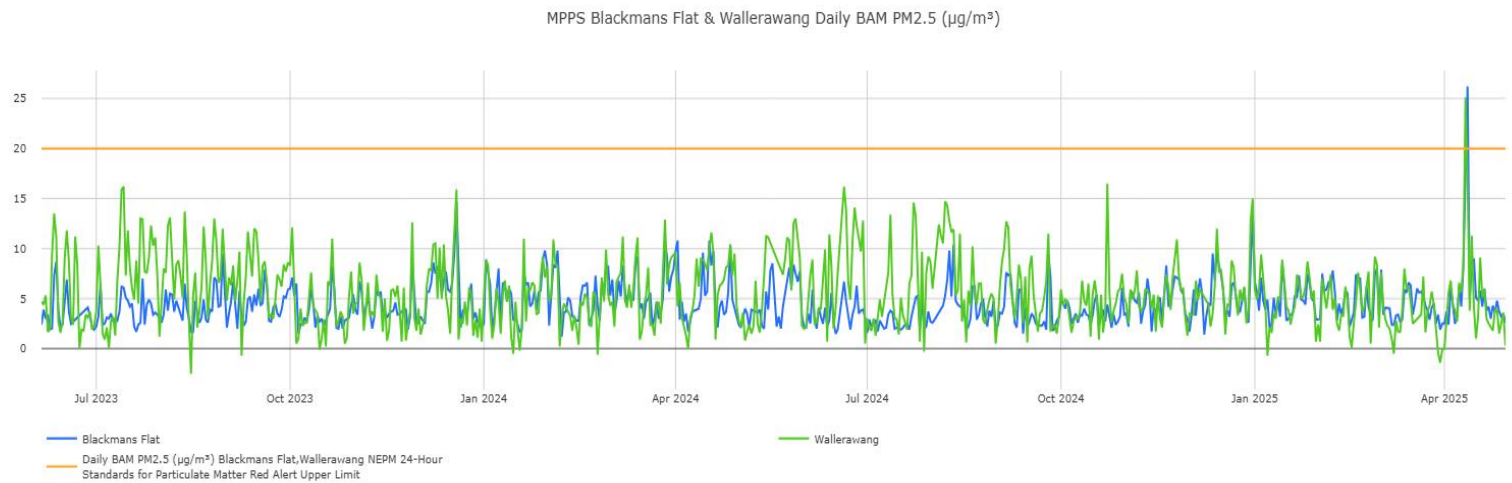


Figure 4: MPPS PM2.5 ($\mu\text{g}/\text{m}^3$) Daily Average

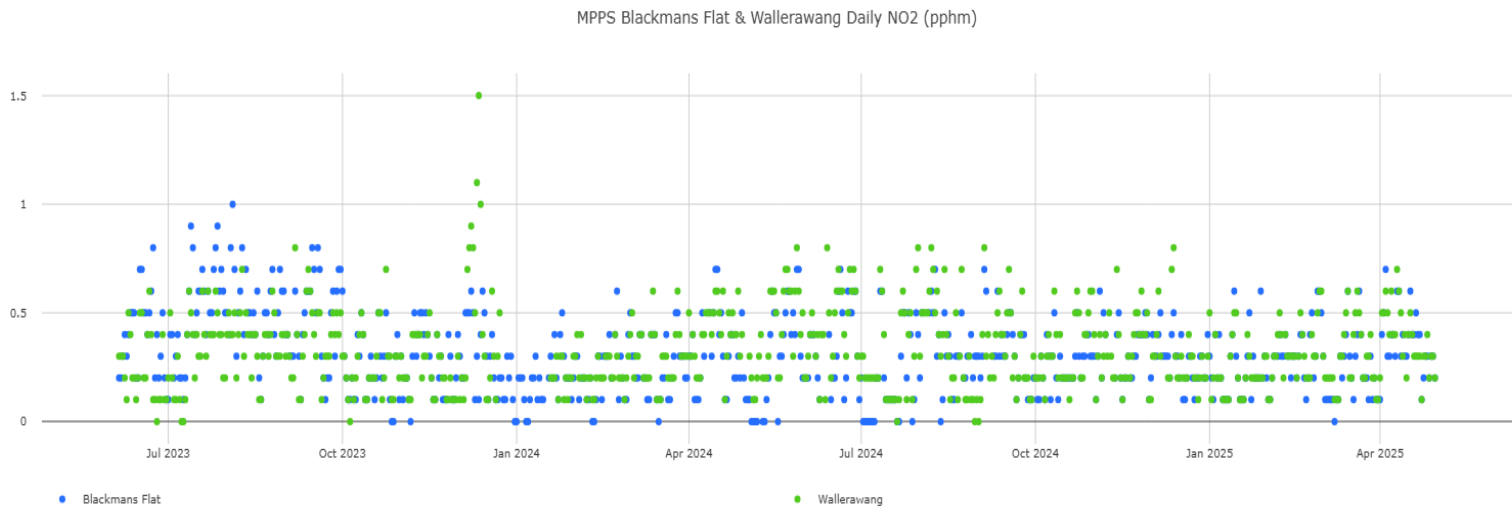


Figure 5: MPPS NO2 pphm Daily Average

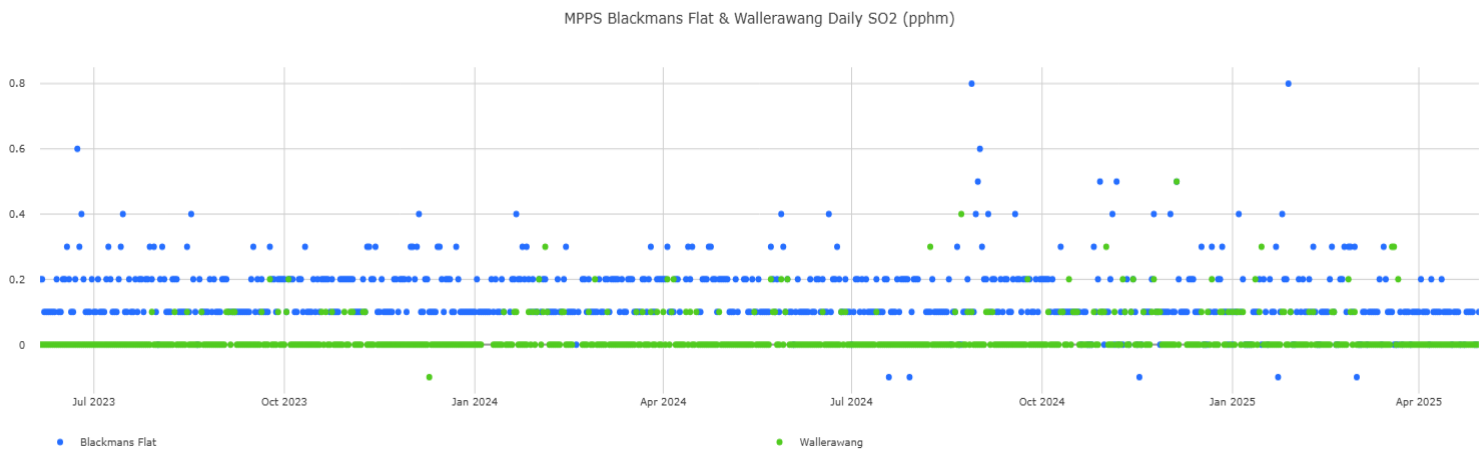


Figure 6: MPPS SO2 pphm Daily Average

Table 10: TCR Water Quality and TCR Riparian Release

2025	Electrical Conductivity (µS/cm)						TCR Riparian Release (ML/month)
	Thompsons Creek Reservoir*			TCR Riparian Release**			
	Lowest Sample Value	Median Sample Value	Highest Sample Value	Lowest Sample Value	Median Sample Value	Highest Sample Value	
January	478	478	478	NR	NR	NR	39
February	479	479	481	NR	NR	NR	208
March	479	480	482	478	491	496	571
April	480	481	482	475	486	498	71
May	494	495	495	458	473	491	449
June							
July							
August							
September							
October							
November							
December							

Sampling Frequency: *Thompsons Creek Reservoir: Continuous Sampling and ** TCR Riparian Release: Weekly Sampling
**TCR Riparian Release = TCD 100 mm Riparian Release

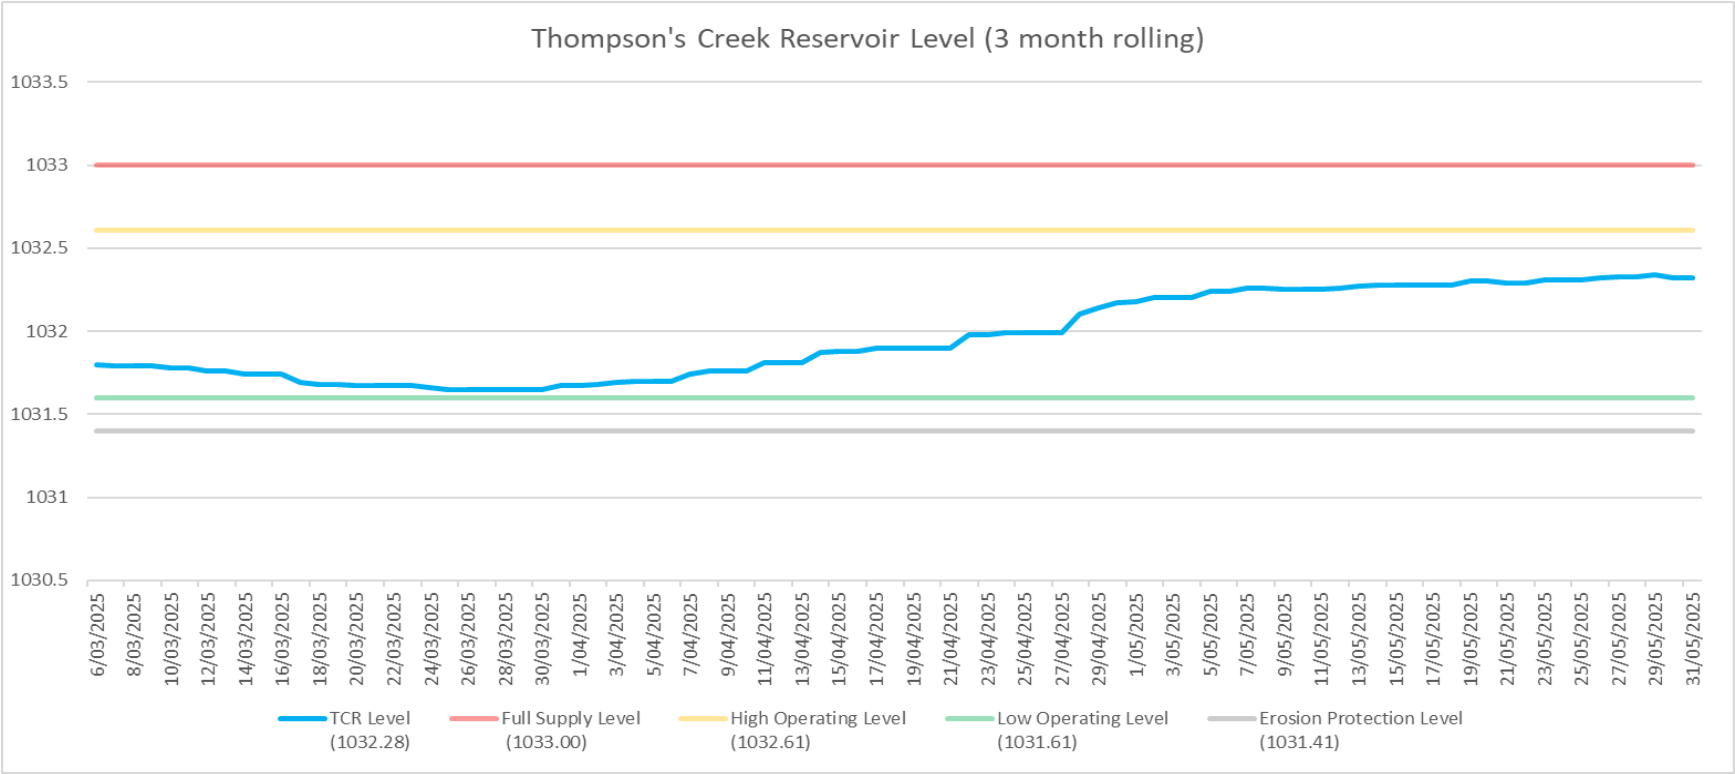


Figure 7: TCR Water Level